

Soil De-compaction and Testing Requirements

Soil Compaction Testing Requirements

1. Subject soils prior to the application of topsoil (see permanent seeding and stabilization notes for topsoil requirements) shall be free of excessive compaction to a depth of 6.0 inches to enhance the establishment of permanent vegetative cover.
2. Areas of the site which are subject to compaction testing and/or mitigation are **explicitly denoted** on the certified soil erosion control plan.
3. Compaction testing locations are denoted on the plan. A copy of the plan or portion of the plan shall be used to mark locations of tests, and attached to the compaction remediation form, available from the local soil conservation district. This form must be filled out and submitted prior to receiving a certificate of compliance from the district.
4. In the event that testing indicates compaction in excess of the maximum thresholds indicated for the simplified testing methods (see details below), the contractor/owner shall have the option to perform either (1) compaction mitigation over the entire mitigation area denoted on the plan (excluding exempt areas), or (2) perform additional more detailed testing to establish the limits of excessive compaction whereupon only the excessively compacted areas would require compaction mitigation. Additional detailed testing shall be performed by a trained, licensed professional.

Compaction Testing Methods

- A. Probing Wire Test (see detail)
- B. Hand-held Penetrometer Test (see detail)
- C. Tube Bulk Density Test (licensed professional engineer required)
- D. Nuclear Density Test (licensed professional engineer required)

Note: Additional testing methods which conform to ASTM standards and specifications, and which produce a dry weight, soil bulk density measurement may be allowed subject to District approval.

Soil compaction testing is not required if/when subsoil compaction remediation (scarification/cultivation (6" minimum depth) or similar) is proposed as part of the sequence of construction.

Procedures for Soil Compaction Mitigation


Procedures shall be used to mitigate excessive soil compaction prior to placement of topsoil and establishment of permanent vegetative cover.

Restoration of compacted soils shall be through deep scarification/cultivation (6" minimum depth) where there is no danger to underground utilities (cables, irrigation systems, etc.). In the alternative, another method as specified by a New Jersey Licensed Professional Engineer may be subject to District Approval.

Simplified Testing Methods



Probing Wire Test - 15.5 ga steel wire (survey flag)

Note: soil should be moist but not saturated. Do not test when soil is excessively dry or subject to freezing temperatures. Slow, steady downward pressure used to advance the wire.

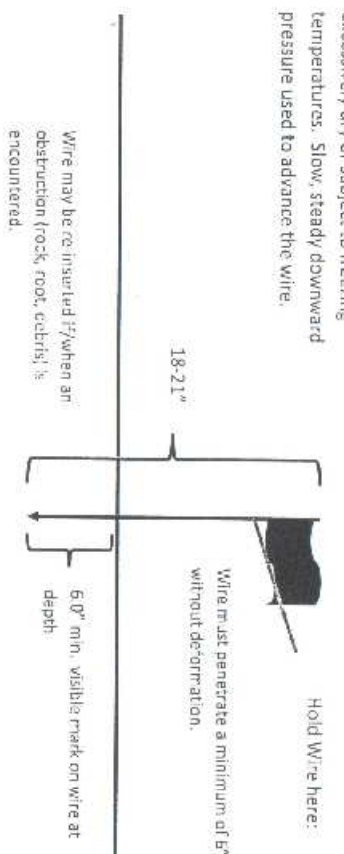

Handheld Soil Penetrometer Test

Note: soil should be moist but not saturated. Do not test when soils excessively dry or subject to freezing temperatures. Slow, steady downward pressure used to advance the probe. Probe must penetrate at least 6" with less than 300 psi reading on the gauge.

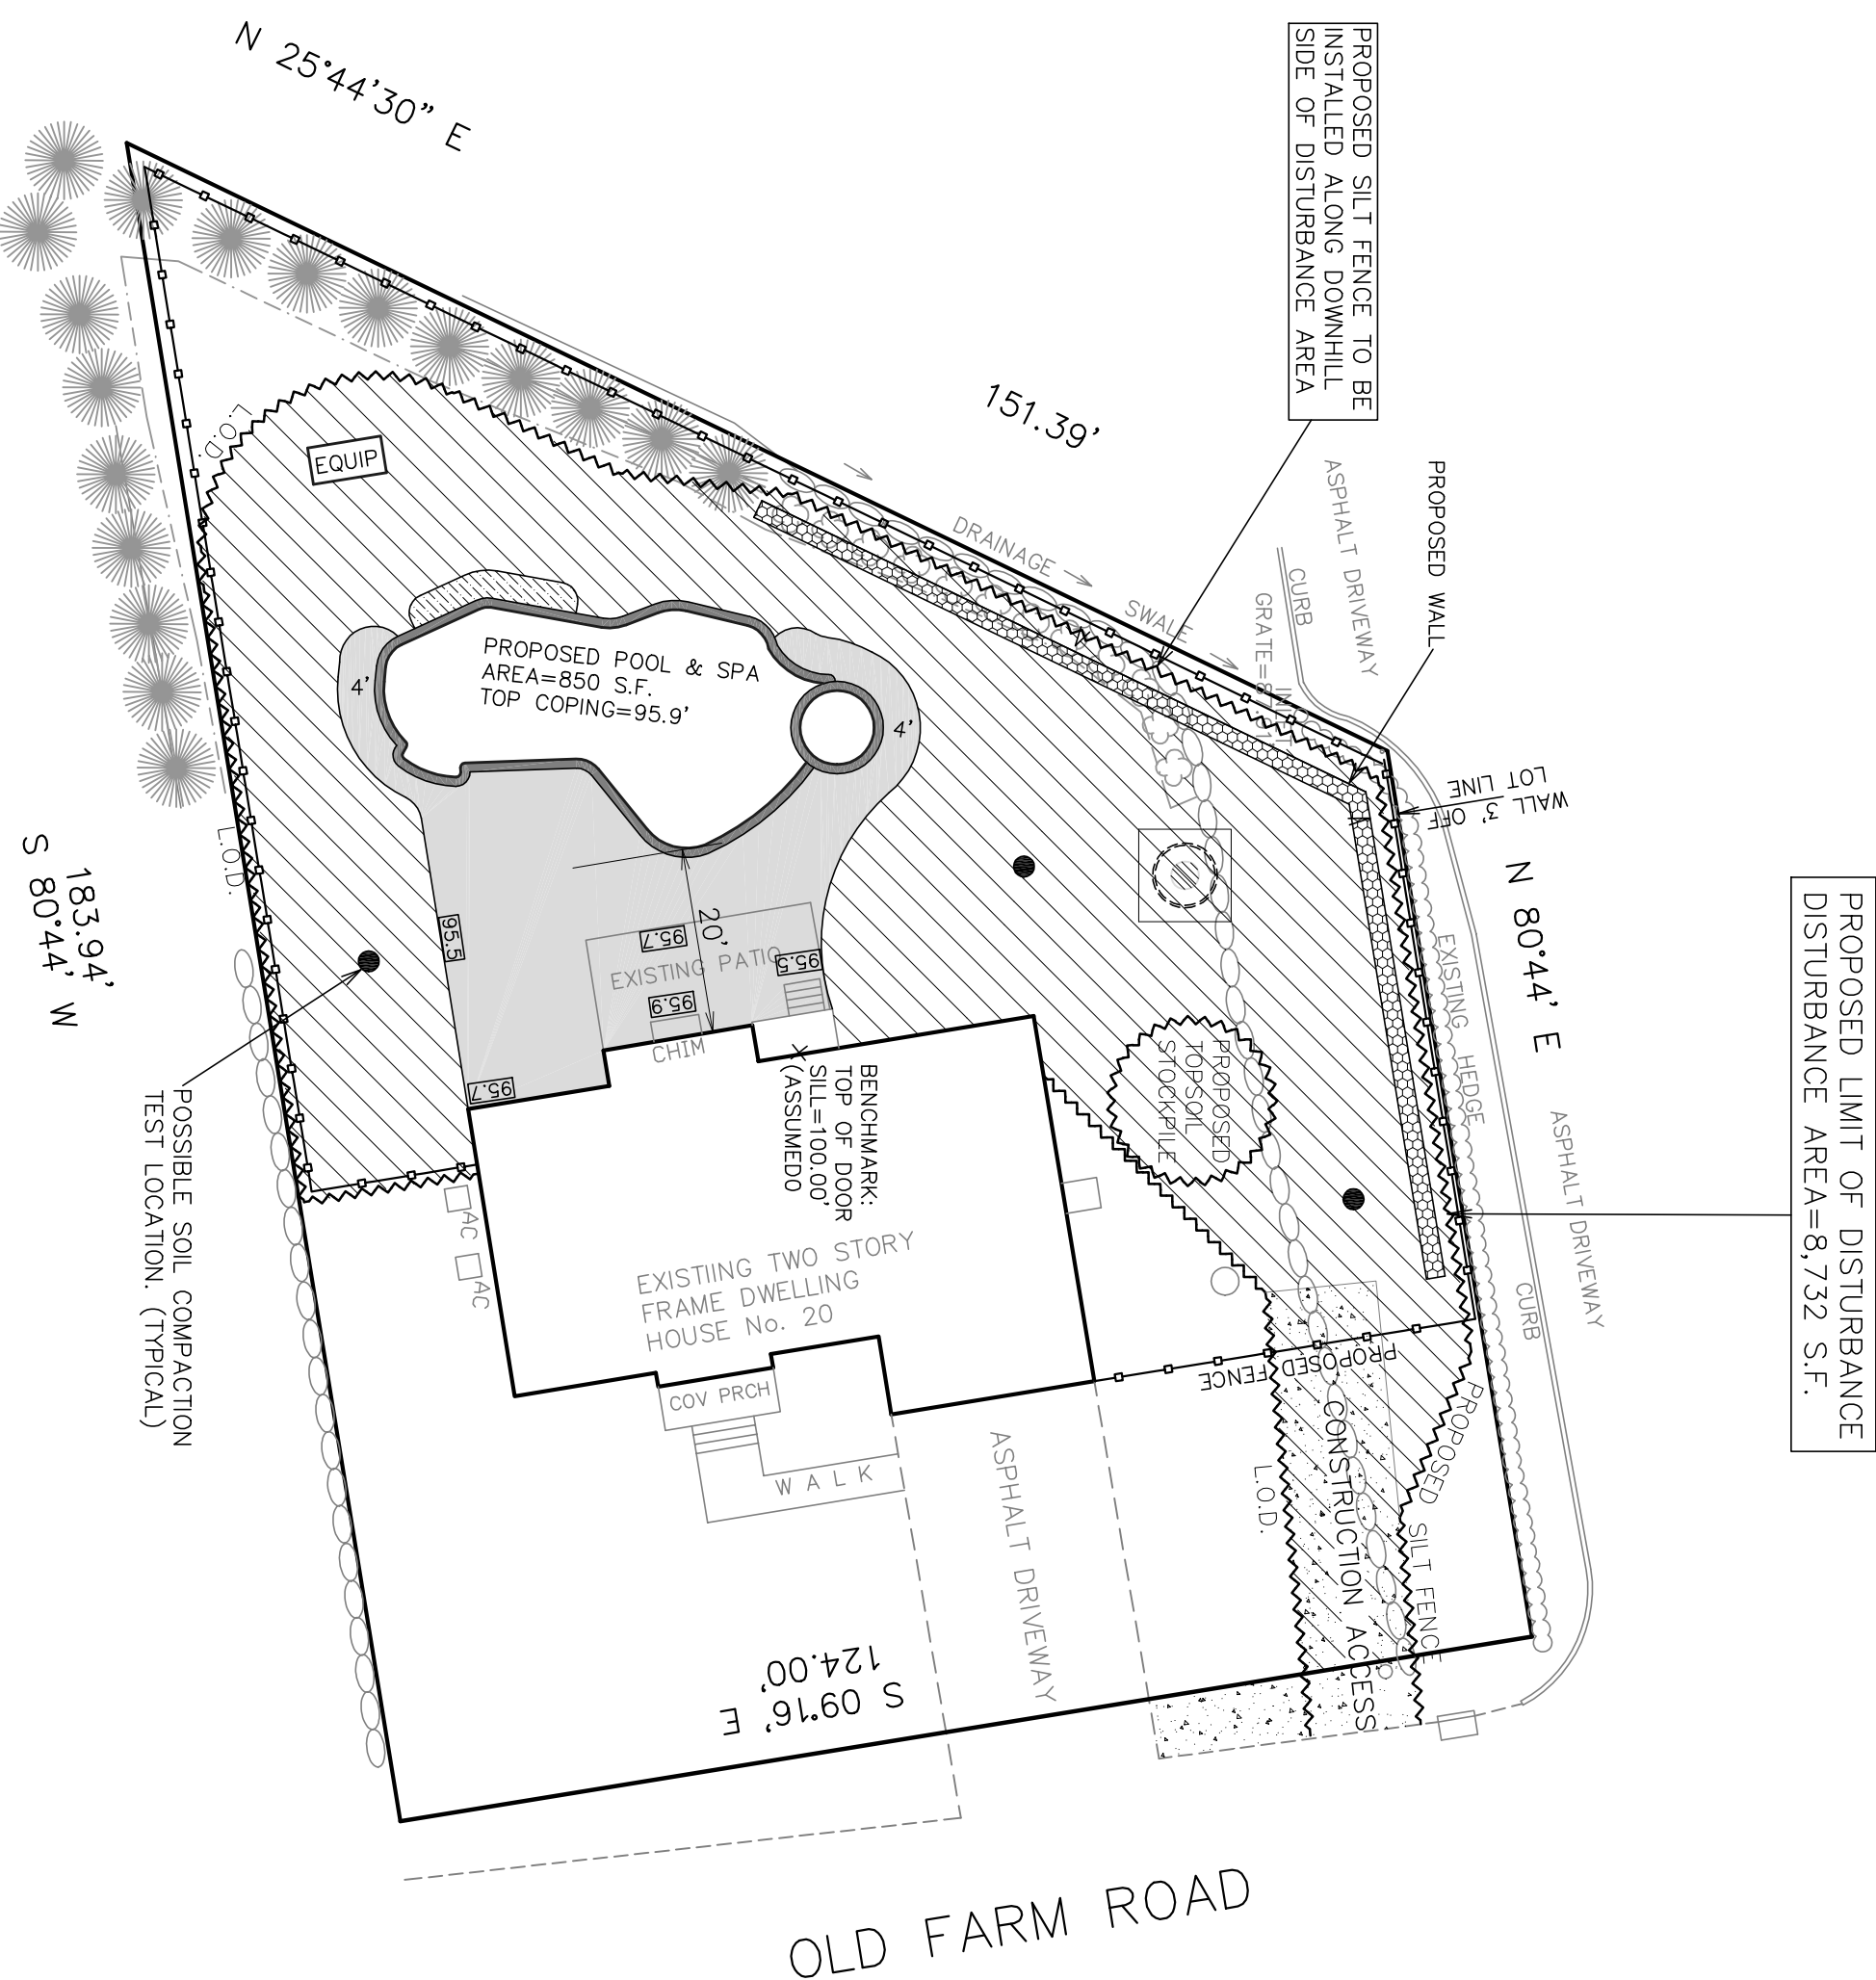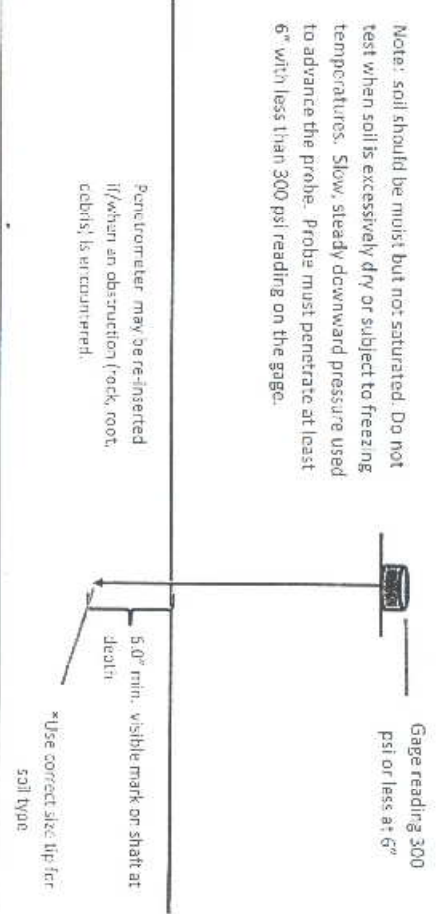


PROPOSED LIMIT OF DISTURBANCE
DISTURBANCE AREA=8,732 S.F.

LEGEND:

- PROPOSED SOIL COMPACTION TEST LOCATION (LOCATION & AMOUNT OF TEST LOCATIONS TO BE DETERMINE BY SUSCD)
- ▨ AREA SUBJECT TO COMPACTION TESTING
- ▭ PROPOSED POOL PATIO

- ~ L.O.D. LIMIT OF DISTURBANCE
- ▨ PROPOSED SILT FENCE ON DOWNHILL SIDE OF L.O.D.
- ▨ PROPOSED ORANGE CONSTRUCTION/SAFETY FENCE AROUND THE EXCAVATION AREA.

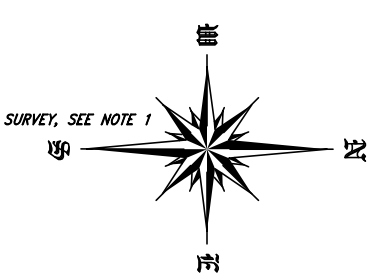

PROPOSED DISTURBANCE AREA = 8,732 S.F.

POOL AND SOIL EROSION & SEDIMENT CONTROL PLAN & SOIL COMPACTION MITIGATION PLAN

for
Ryvicker Residence
situated in
TOWNSHIP OF BERKLEY HEIGHTS,
UNION COUNTY, NEW JERSEY.
Being known as Lot 64.02, Block 2801

CERT. AUTH#24GA28280500 NJPLS & PE #24GB031272
MARK J. MANTYLA, MEMBER
PROFESSIONAL ENGINEER,
PLANNER & LAND SURVEYOR.
MJM SURVEYING & ENGINEERING, LLC
139 West Mountain Road,
Sparta, N.J. 07871
Cell No. 973-222-6986

DATE: September 16, 2020

